



The Grid: Integration of Renewable Energy


Solar Photovoltaic Energy

March 16, 2011



Variable Asynchronous Generation

Technology Change in the Utility Industry

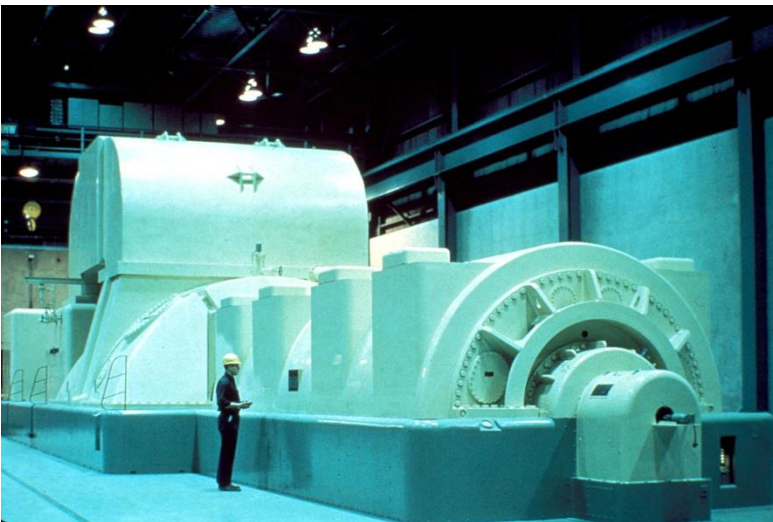

Spinning Iron - Rules and expectations formed around conventional generators



How do we set expectations/requirements for new technologies

Solar PV Grid Integration

Modular design from rooftop system to utility-scale power plant




- Distributed Generation
 - Rooftop or small ground mounted systems
 - Either on the customer side of the meter to offset retail purchases or on the utility side selling into a FIT
 - Increased inverter functionality supporting the grid allow for higher penetrations
 - Germany – 17,000 MW of PV installed in 840,000 sites



- Utility-Scale Solar Power Plants
 - Connected directly to the utility high voltage grid
 - Utility Scale
 - 80 MW_{ac} plant in operation at Sarnia, ONT
 - 290 MW_{ac} plant under construction in AZ
 - 550 MW_{ac} plants in advanced development in CA
 - Advanced controls to support electric grid stability and operability

Typical Solar Energy Production and System Demand

Average August PV Supply and CAISO Peak Demand

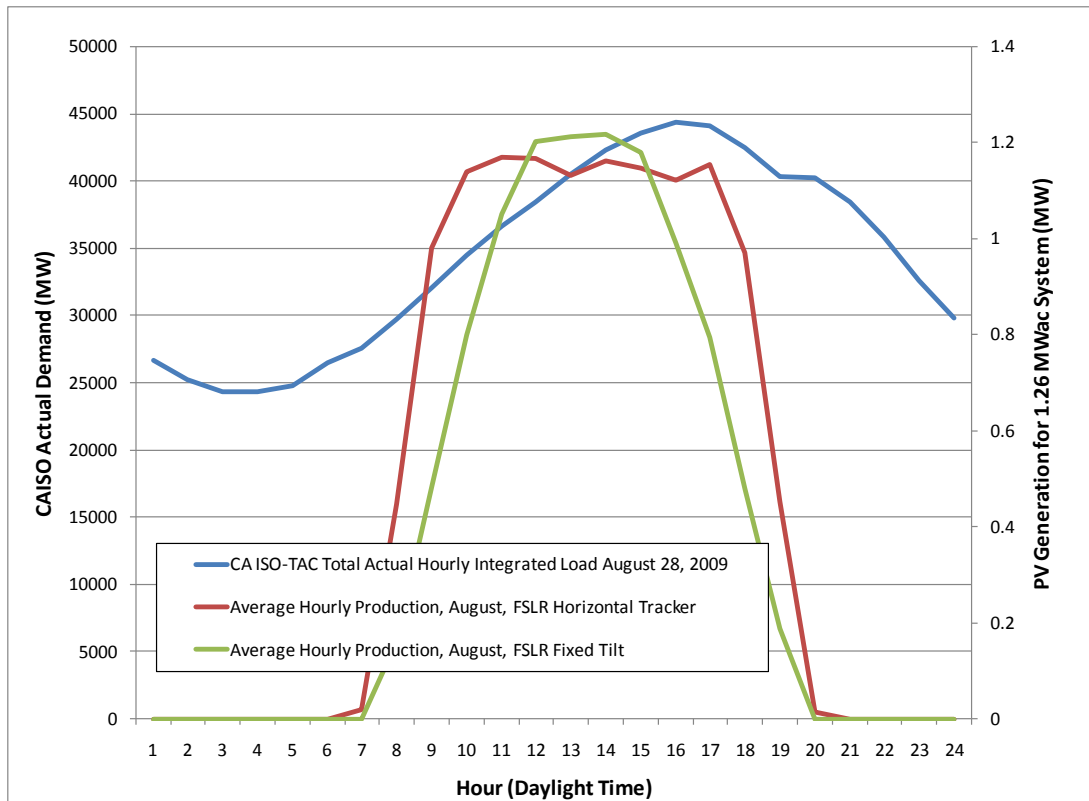

*CAISO Hourly Demand from CAISO OASIS Data Service for August 28, 2009 (third highest demand day for CAISO for 2009)

Renewables Integration – Short Term Variability



Figure 2.11: PV plant output on a sunny day (Sampling time 10 seconds)



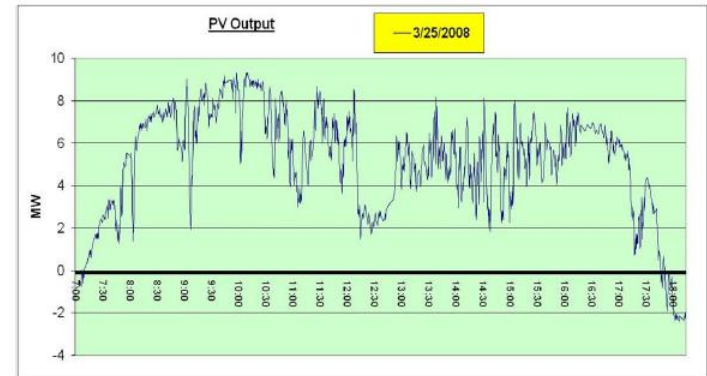


Figure 2.12: PV Plant output on a partly-cloudy day (Sampling time 10 seconds)

Spatial Diversity & Short Term Variability

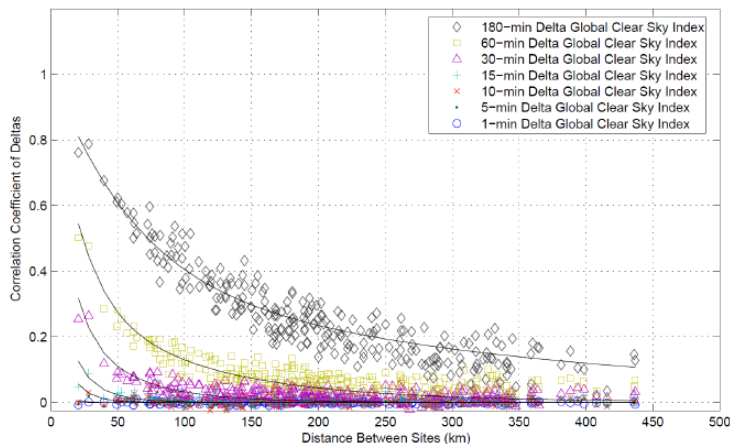

Short time scale changes in insolation are uncorrelated between sites

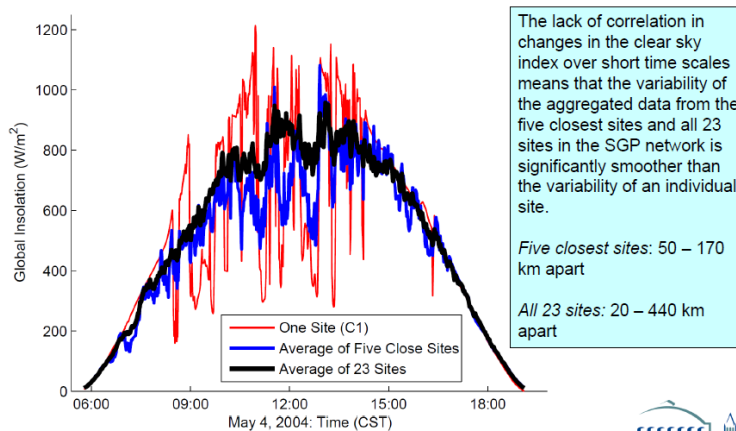

Aggregate variability at multiple sites is significantly smoother than individual sites